




PROFILE
TYPE A

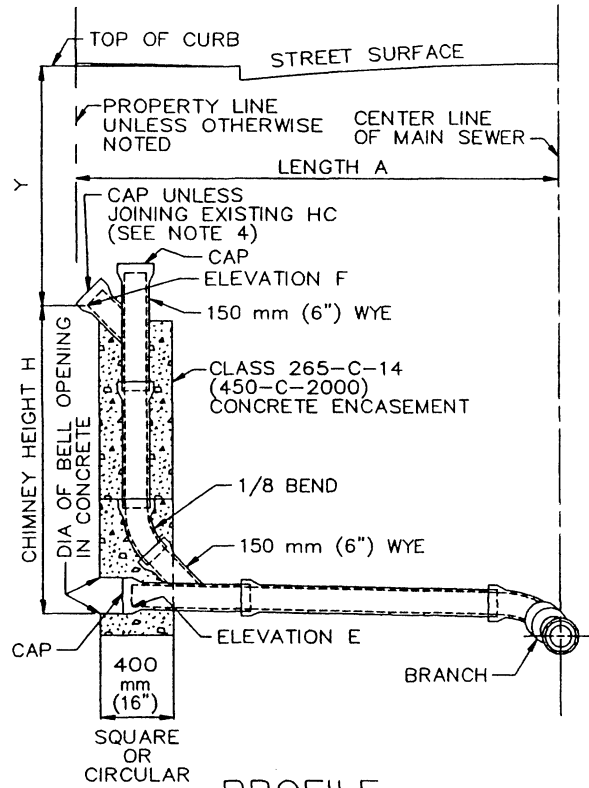

PROFILE
TYPE B

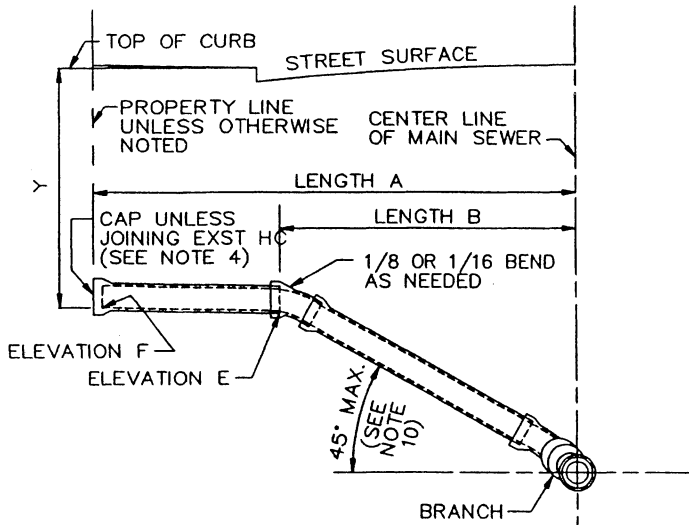

PROFILE
TYPE C

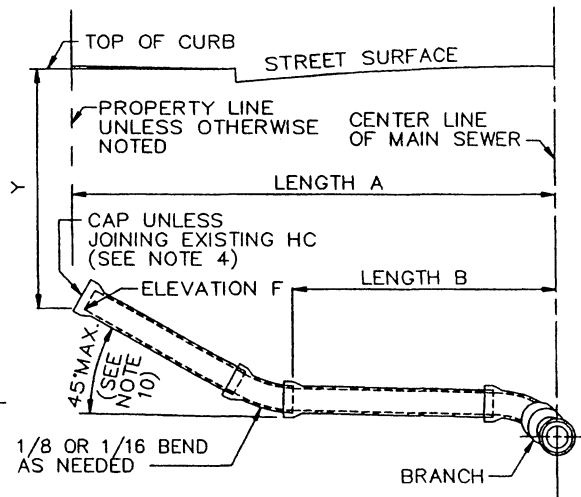

PROFILE
TYPE D

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996

HOUSE CONNECTION SEWER

STANDARD PLAN
METRIC
222-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES

1. EXCEPT AS OTHERWISE INDICATED ON THE PLANS, ALL HOUSE CONNECTION SEWERS SHALL BE TYPE "A" AND SHALL BE CONSTRUCTED ON STRAIGHT LINES AND GRADES BETWEEN CONTROL POINTS AND ELEVATIONS.
2. DIMENSIONS:
 - A. $Y = 1.85 \text{ m (6')}$
 - B. LENGTHS "A" AND "B" - SEE PLANS
 - C. HEIGHT "H" - SEE PLANS
 - D. ELEVATIONS "E" AND "F" - SEE PLANS
3. ALL HOUSE CONNECTION SEWER PIPE SHALL BE 150 mm (6") UNLESS OTHERWISE INDICATED AND MAY BE ANY OF THE FOLLOWING:
 - A. VC PIPE
 - B. PE PIPE
 - C. ABS SOLID WALL PIPE
 - D. ABS COMPOSITE PIPE
 - E. PVC PLASTIC PIPE

PROVIDED THAT CHANGES FROM ONE TYPE OF MATERIAL OR SIZE TO ANOTHER SHALL BE MADE ONLY BY MEANS OF SUITABLE ADAPTERS APPROVED BY THE ENGINEER.

4. THE UPPER END OF THE HOUSE CONNECTION SHALL BE SEALED BY INSTALLING A CAP AND SEALING THE CAP WITH 25 mm (1") THICK TYPE "F" MORTAR AROUND THE CIRCUMFERENCE OF THE CAP.
5. EXCEPT AS CONTROLLED BY ELEVATIONS INDICATED ON THE PROJECT PLANS, THE MINIMUM SLOPE FOR ALL PIPE SHALL BE 2% ($S=0.02$ MINIMUM).
6. THE FIGURE IN A CIRCLE ON THE PLANS ADJACENT TO A HOUSE CONNECTION SEWER STATION INDICATES THE DEPTH IN METERS (FEET) BELOW THE EXISTING TOP OF CURB TO WHICH THE INVERT OF THE UPPER END OF THE HOUSE CONNECTION SEWER SHALL BE CONSTRUCTED. IF NO DEPTH IS INDICATED, THE INVERT OF THE UPPER END SHALL BE THE ELEVATION SHOWN ON THE PROFILE. WHERE NEITHER DEPTH NOR ELEVATION IS INDICATED, THE INVERT SHALL BE 1.85 m (6') BELOW THE TOP OF THE EXISTING CURB.
7. BRANCHES SHALL BE EITHER TEES OR WYES AND SHALL BE ROTATED UPWARD FROM THE HORIZONTAL TO AN ANGLE OF 22-1/2' TO 45' WHEN TEES ARE USED. BENDS ARE NOT REQUIRED BUT MAY BE USED AT THE OPTION OF THE CONTRACTOR. WHEN THE BRANCH ROTATION DOES NOT CONFORM TO THE SLOPE OF THE HOUSE CONNECTION SEWER, PULLED JOINTS MAY BE USED FOR ADJUSTMENT.
8. THE MAXIMUM DEFLECTION AT EACH JOINT FOR 100 mm (4") AND 150 mm (6") VITRIFIED CLAY PIPE HOUSE CONNECTION SEWERS SHALL BE 4", WHICH IS EQUAL TO A PULL OF 14 mm (9/16") FOR A 150 mm (6") PIPE AND 10 mm (3/8") FOR A 100 mm (4") PIPE. (PULL IS DEFINED AS THE SEPARATION OF THE ABUTTING PIPE ENDS ON THE CONVEX SIDE OF THE CURVE MEASURED AT THE OUTSIDE PIPE BARREL).
9. CONNECTION OF A BUILDING SEWER SMALLER THAN 150 mm (6") TO A 150 mm (6") HOUSE CONNECTION SEWER SHALL BE MADE USING AN APPROVED INCREASER TEE OR AN INCREASER FOLLOWED BY A TEE.
10. ALL HOUSE CONNECTION SEWERS OR PORTIONS THEREOF CONSTRUCTED ON A SLOPE EXCEEDING 45' SHALL BE ANCHORED PER SPPWC 221.
11. HOUSE CONNECTION SEWERS CONSTRUCTED PURSUANT TO A HOUSE CONNECTION PERMIT SHALL CONFORM TO ALL APPLICABLE STATUTES AND ORDINANCES.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

HOUSE CONNECTION SEWER

STANDARD PLAN
METRIC

222-1

SHEET 2 OF 2