



ANAHEIM FIRE & RESCUE
Community Risk Reduction Division
201 S. Anaheim Blvd., #300
Anaheim, CA 92805
(714) 765-4040
tradeshowspector@anaheim.net



GLOVER STADIUM EVENTS SPECIFICATIONS & REQUIREMENTS

All events shall provide an approve method of tracking and maintaining the listed occupant loads, such as issuing tickets, wrist bands or by counting attendees upon entry and exiting. Events that are outside of the standard event setup may require a fee-based floorplan submittal to the City of Anaheim Community Services Department and Anaheim Fire & Rescue. The requirements and occupant load for Glover Stadium shall meet the following conditions:

I. Permanent Stadium Bleacher Seating (North Side)

1. Permanent bleacher seating on the north side shall be limited to an occupant load maximum of 3000 people.
2. The field shall be limited to an occupant load maximum of 1000 people.
3. All exit and egress gates surrounding the Stadium on the north side shall be kept open or unlocked and staffed by Anaheim Community Services personnel or by trained personnel that is approved by Community Services and/or Anaheim Fire & Rescue.
4. Vendor displays are permitted in-between restrooms and in front of concession 6-feet in depth. See attached diagram for approved locations.

II. Temporary Bleacher Seating (South Side)

1. Temporary bleacher seating on the south side of the field shall be limited to an occupant load of 2000 people.
2. All exit and egress gates surrounding the south side of the temporary stadium bleachers shall be kept open or unlocked and staffed by city personnel or by trained personnel that is approved by Anaheim Community Services and/or Anaheim Fire & Rescue.


IV. General Information

1. Open flame devices including fire performers require a permit from Anaheim Fire & Rescue and are fee based. Pyrotechnics and special effects, including cold spark devices or sparklers requires a License from the California State Fire Marshal's Office and a Fireworks Permit from Anaheim Fire & Rescue. Please contact tradeshowspector@anaheim.net for more information.
2. Vehicles, food trucks, cooking booth or displays shall not be placed in exit and/or egress paths around the stadium or under bleachers. The use of propane/butane or flammable liquids shall not be used inside the stadium. See attached diagram for approved locations.
3. Cooking booths shall have a serviced and tagged 2A10BC fire extinguisher and canopies shall be flame retardant and tagged by the manufacture. Barbeques and deep fat fryers shall be placed outside canopies. Provide a serviced and tagged K fire extinguisher for cooking booths with deep fat fryers.
4. Vendor booths inside Glover Stadium shall be in designated areas approved by Anaheim Community Services and Anaheim Fire & Rescue.
5. Commercial filming requires a Filming Permit from the City of Anaheim Public Works Department and notification to Anaheim Fire & Rescue. Fire Stand-by will be determined on a case-by-case basis.
6. For custom bleacher stands, California structural engineered stamped plans shall be submitted to the City of Anaheim Building Department a minimum of 30 days prior to the event date.
7. Carnivals, fairs or the use of tents or canopies that exceed 400 square feet require a permit from Anaheim Fire & Rescue.
8. Power Cables in aisles or exit paths, shall be taped down or ramped to prevent trip hazards.

To Request this brochure in an alternative format, please call (714) 765-4040 or TTY (714) 765-5125. The City prohibits discrimination on the basis of race, color or national origin in programs, services and activities.



GLOVER STADIUM VENDOR LOCATION

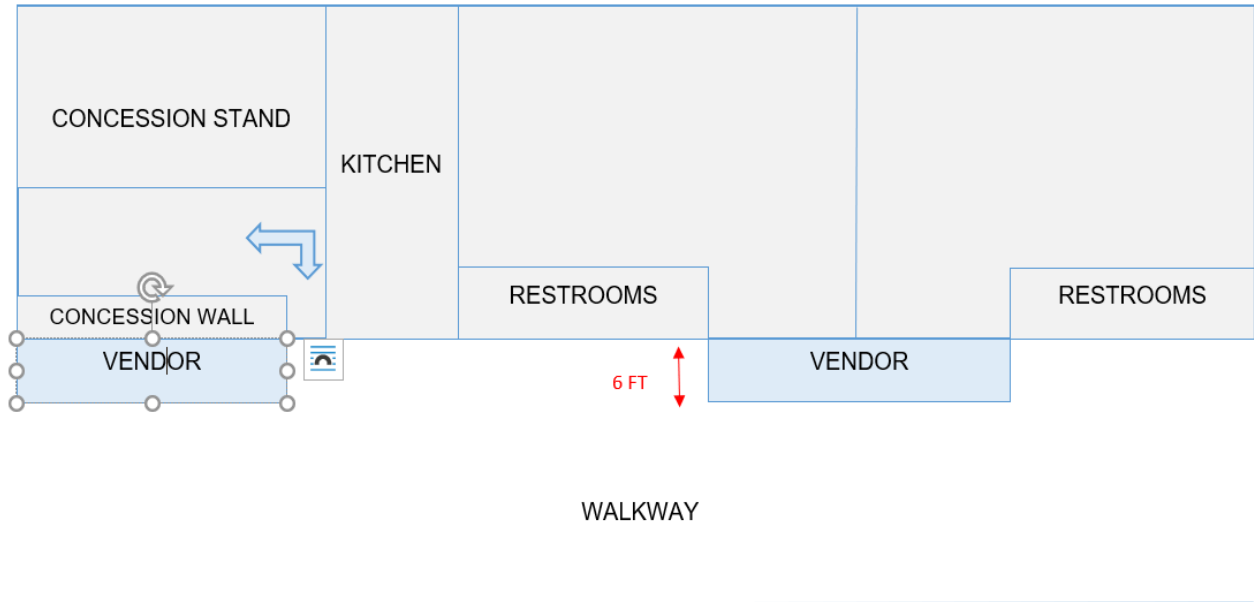

GLOVER STADIUM VENDOR/COOKING LOCATION

