


SCOPE: THIS STANDARD SHOWS MINIMUM CLEARANCE BETWEEN CONDUCTORS AND STREET LIGHT POLES.

OVERHEAD SERVICE

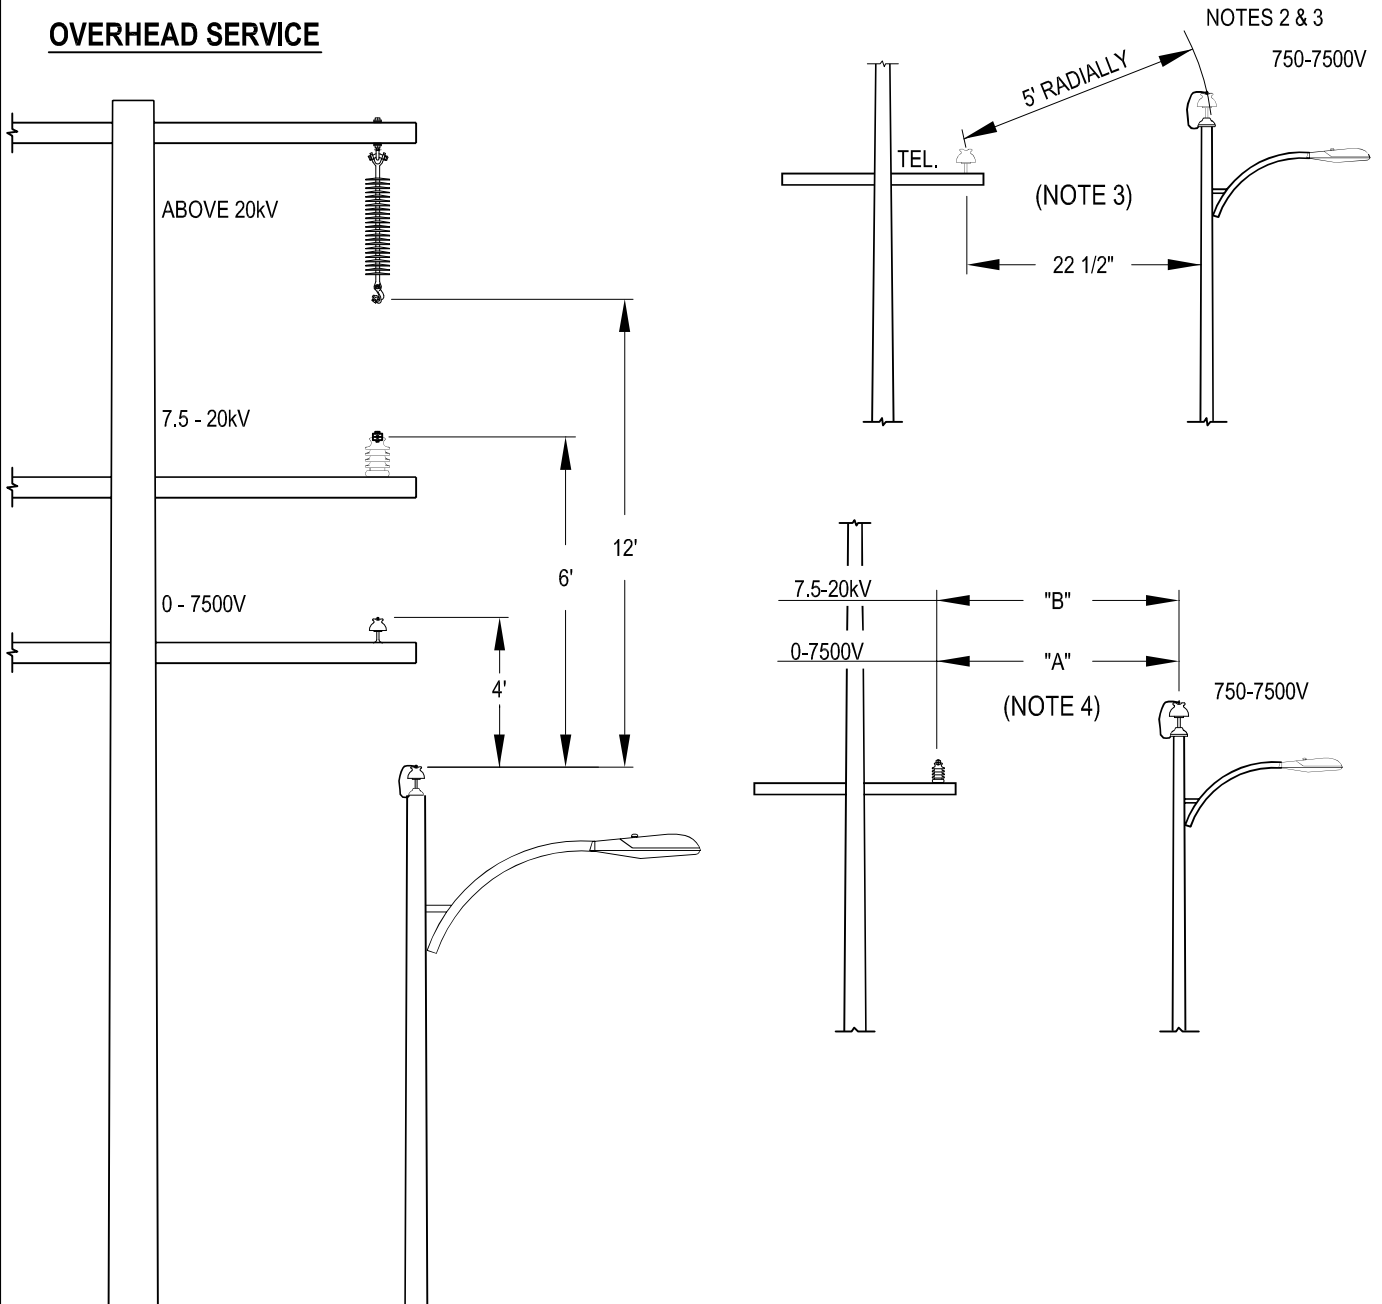

FILENAME: L101 REV2

	SPAN (OF POWER CIRCUIT)				
	0-150 FT.	151-200 FT.	201-250 FT.	251-300 FT.	OVER 300 FT.
A	4'-10"	5'-8"	6'-0"	7'-4"	8'-0"
B	6'-7"	7'-5"	7'-9"	8'-1"	9'-6"

CITY OF ANAHEIM
PUBLIC UTILITIES DEPARTMENT
ELECTRICAL DIVISION
T&D CONSTRUCTION STANDARDS

APPROVALS

T&D MGR	FIELD MGR	OPER. MGR

REVISION KEYS: ADDED / REVISED TEXT ADDED / REVISED MATERIAL

MINIMUM CLEARANCE BETWEEN CONDUCTORS AND STREET LIGHT POLES

NEW SHEET

REVISION NO. **2**

ISSUE DATE: **01-08**

SHEET **1** OF **2**



CONSTRUCTION STANDARD:

L 101

UNDERGROUND SERVICE

NOTES:

1. NO SPECIFIED CLEARANCE IS REQUIRED IF THE STREET LIGHTING POLE IS NON-CLIMBABLE AND THE CABLE IS SUITABLY INSULATED AND MECHANICALLY PROTECTED.
2. MAY BE REDUCED TO 4' IF TELEPHONE POLE IS OVER 6' (42") FROM ST. LT. CONDUCTOR.
3. THIS ALSO APPLIES TO THE CLEARANCE OF A TELEPHONE CABLE FROM THE CENTER LINE OF THE ELECTROLIER. IT MAY BE REDUCED TO 15" WHERE THE TWO POLES ARE LESS THAN 10" APART.
4. IF STREET LIGHT POLE IS LOCATED WITHIN 10' OF POWER POLE DIMENSION "A" CAN BE 4'-2" AND "B" 6'-0" REGARDLESS OF SPAN.
5. IF STREET LIGHT POLE IS LOCATED WITHIN 10' OF POWER POLE, DIMENSION "A" CAN BE 3 FT. REGARDLESS OF SPAN.

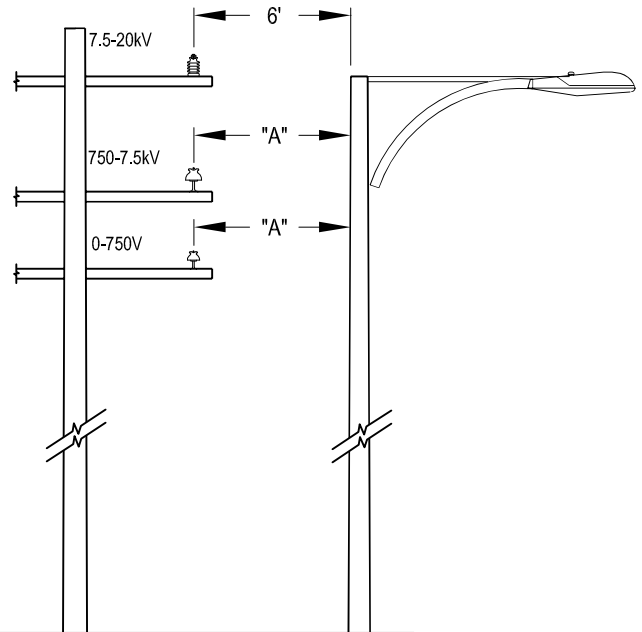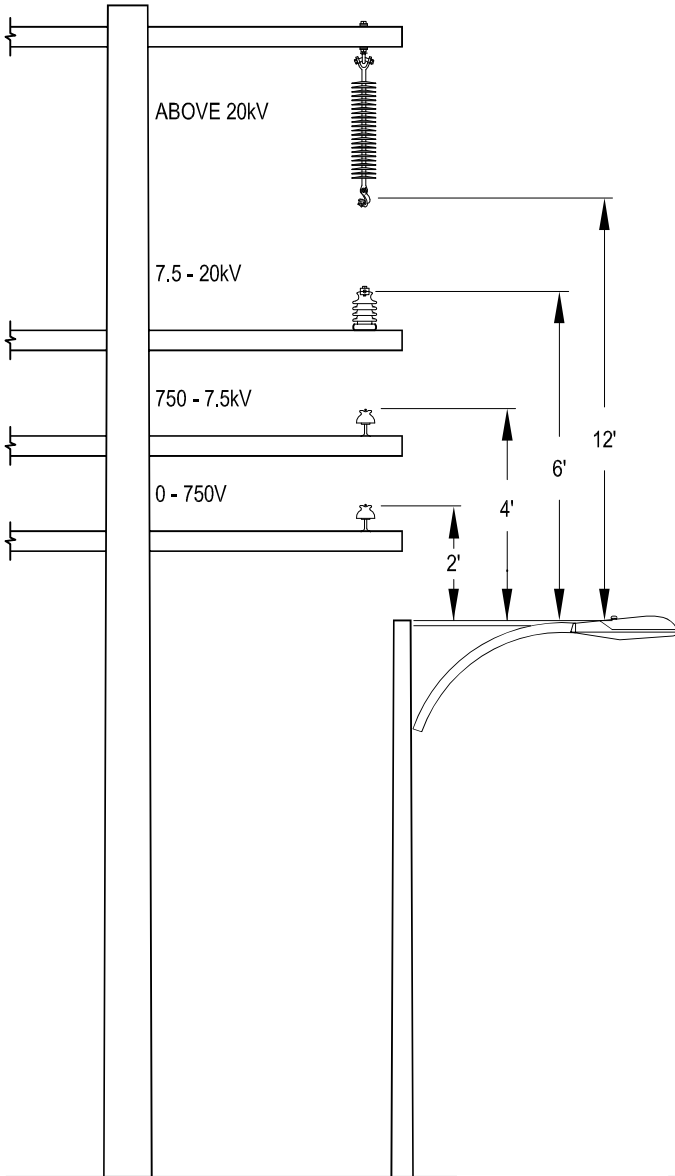

FILENAME: L 101 REV2

	SPAN				
	0-150 FT.	151-200 FT.	201-250 FT.	251-300 FT.	OVER 300 FT.
A	3'-0"	3'-8"	4'-0"	5'-6"	6'-0"

RENAMED FROM L 101-1

<p>CITY OF ANAHEIM PUBLIC UTILITIES DEPARTMENT ELECTRICAL DIVISION T&D CONSTRUCTION STANDARDS</p>	REVISION KEYS:	<div style="display: flex; align-items: center; gap: 5px;"> <div style="width: 15px; height: 10px; background-color: #cccccc; border: 1px solid black;"></div> ADDED / REVISED TEXT </div> <div style="display: flex; align-items: center; gap: 5px; margin-top: 5px;"> <div style="width: 15px; height: 10px; background-color: #cccccc; border: 1px solid black;"></div> <div style="font-size: 12px;">➔</div> ADDED / REVISED MATERIAL </div>	NEW SHEET						
	<p>MINIMUM CLEARANCE BETWEEN CONDUCTORS AND STREET LIGHT POLES</p>		REVISION NO. 2						
	<p>APPROVALS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%; font-size: 8px;">T&D MGR</td> <td style="width: 33%; font-size: 8px;">FIELD MGR</td> <td style="width: 33%; font-size: 8px;">OPER. MGR</td> </tr> <tr> <td style="text-align: center;"></td> <td style="text-align: center;"></td> <td style="text-align: center;"></td> </tr> </table>		T&D MGR	FIELD MGR	OPER. MGR				ISSUE DATE : 01-08
	T&D MGR	FIELD MGR	OPER. MGR						
<p>L 101</p>		SHEET 2 OF 2 CONSTRUCTION STANDARD:							